Model 950XL3



Double Check Valve Assembly

Application

Ideal for use where Lead-Free* valves are required. Designed for installation on potable water lines to protect against both backsiphonage and backpressure of polluted water into the potable water supply. Assembly shall provide protection where a potential non-health hazard exists.

Standards Compliance (Horizontal and Vertical)


- ASSE® Listed 1015
- UPC® Listed
- AWWA Compliant C510
- Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern California
- · Meets the requirements of NSF/ANSI/CAN 61 and 372*
- *(Less than 0.25% Weighted Average Lead Content)
- Not available for sale or use in Canada

Materials

Main valve body	Low Lead Cast Bronze ASTM B 584					
Access cover	Low Lead Cast Bronze ASTM B 584					
Fasteners	Stainless Steel, 300 Series					
Elastomers	Silicone (FDA Approved)					
	Buna Nitrile (FDA Approved)					
Polymers	NoryI™					
Springs	Stainless Steel, 300 Series					
Ball valve handles	Stainless Steel					

Features

20 PSI
175 PSI
33°F
180°F
350 PSI
ANSI B1.20.1

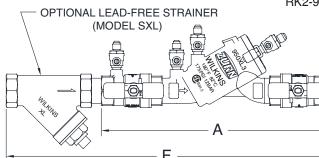

Dimensions & Weights (do not include pkg.)

		DIMENSIONS (approximate)										WEIGHT			
MODEL SIZE		A		ВС			D		E		F		WITH BALL VALVES		
in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg
3/4	20	9 15/32	241	1 9/16	42	1 5/16	34	3 3/16	82	11/16	18	14 3/16	358	3.4	1.5
1	25	11 3/4	299	1 15/16	49	1 1/2	39	3 7/16	87	7/8	22	17 9/16	446	5.2	2.4
1 1/4	32	15 1/4	387	2 1/2	64	1 5/8	42	4 1/4	109	1 3/16	29	20 3/8	518	10.2	4.6
1 1/2	40	15 15/16	405	3 1/16	79	1 5/8	41	4 5/16	110	1 1/4	33	21 9/16	548	11.9	5.4
2	50	17 11/16	449	3 1/2	89	1 15/16	49	5 1/16	128	1 5/8	41	24 5/8	626	18.0	8.2

Rev. F Date: 9/23 Document No. BF-950XL3 Product No. Model 950XL3 Patent zurn.com/patents



Options

(Suffixes can be combined)


- with full port QT ball valves (standard, 3/4" 2"), and with integral male 45° flare SAE test fitting (standard, 3/4" - 1")
- □ FT with integral male 45° flare SAE test fitting (1 1/4" - 2", contact factory for approvals)
- S with Model SXL lead-free bronze wye type strainer
- U with union ball valves (3/4" 2")

Accessories

- □ Repair kits (see repair kit guide for full list)
- □ Thermal expansion tank (Model XT)
- □ QT-SET Quick Test Fitting Set (1 1/4" 2")


Repair Kit Part Numbers


RK34-950XL3 RK1-950XL3 RK114-950XL3 (1 1/4" & 1 1/2") RK2-950XL3

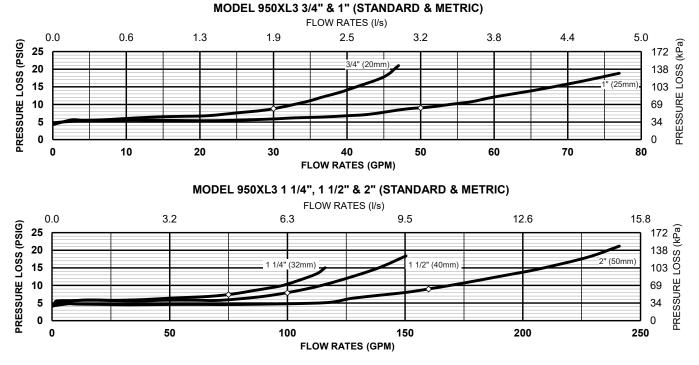


Typical Installation

Local codes shall govern installation requirements. To be installed in accordance with the manufacturer's instructions and the latest edition of the Uniform Plumbing Code. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. The installation shall be made so that no part of the unit can be submerged.

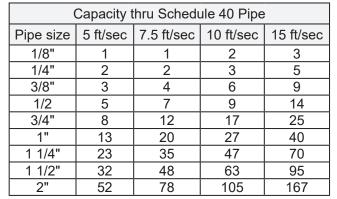

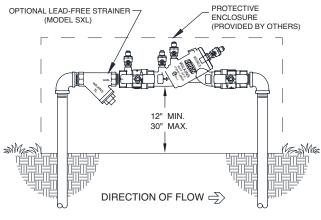



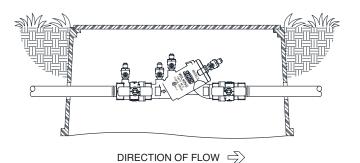

PIT INSTALLATION

Specifications

The Double Check Type Backflow Preventer shall be certified to NSF/ANSI/CAN 61, shall be ASSE Listed 1015, rated to 180°F, and supplied with full port ball valves. The main body and access cover shall be low lead bronze (ASTM B 584), the seat ring and all internal polymers shall be Noryl[™] and the seat disc elastomers shall be silicone. The first and second check shall be located at an angle and accessible for maintenance from the top of the device, without removing the device from the line. The checks shall share a single access cover and test cocks shall be accessible from the top of the device. The Double Check Type Backflow Preventer shall be a ZURN WILKINS Model 950XL3.